

**INSTRUCTIONS MANUAL**

**CONSTANT VOLTAGE CONTROL GEAR FOR LED MODULES**

Type: LV ...-T-IP67

The constant voltage control gears for LED modules use sensitive electronic components and should be handled with the same care as any other electronic equipment. In order to achieve a long life and correct functioning, both in the control gear and in the LED module, it is necessary to follow these manufacturer's recommendations.

**SECURITY**




A very low voltage installation (LVI) must be carried out whilst taking the necessary precautions in order to respect the safety of all its parts. The contact or crossing between the mains supply conductors and the very low voltage installation conductors must be avoided and the insulation between the conductors must be > 4kV. Maintenance and the changing of parts must be carried out by a qualified person with the mains disconnected and the instructions and current regulations must be strictly followed.

**ELECTRICAL SUPPLY**



The voltage and frequency of the power line must be within the normal working range specified on the equipment. The polarity indicated must be respected (phase and neutral). In 400 V triphase installations, it must be ensured that the neutral is always connected; otherwise the 400 V could reach the equipment with the consequent risks. When the installation is being carried out the load distribution between phases must be balanced as much as possible.

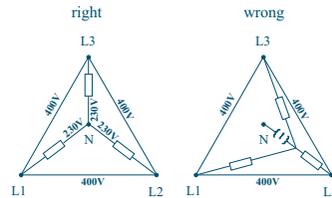

**INSULATION TEST**



If an insulation test in the circuits which supply the LED driver in the installation is carried out, it must be done applying the test voltage between the phases and the neutrals all together and the earth wire. The test voltage must never be applied between the phases and the neutral or between phases.

**OPERATING TEMPERATURE**



It must be ensured that the maximum atmospheric temperature in the installation does not exceed the  $t_a$  marked on the equipment, and an adequate degree of protection against humidity must be provided. Under no circumstances must the  $t_c$  temperature marked on the driver's casing be exceeded due to the fact that continued operation at higher temperatures produces a progressive reduction in life expectancy.

**TERMINAL BLOCK AND WIRE PREPARATION**



The use of rigid wire with a section  $3 \times 1,0 \text{ mm}^2$  primary and  $2 \times 1,0 \text{ mm}^2$  secondary. If a previously inserted wire is to be extracted, do not use excessive force on the connection supports to avoid breaking. The maximum length of the output cable to the LED lamps should not exceed 2m in order to meet the EMC standard.

**INSTALLATION**



Placing a switch in the output of the control gear is not allowed. May cause damages in control gear and LED module.

Any procedure at LED lamp connection must be made without electrical supply.



**PROTECTION SWITCHES**

Each group of control gear for LED modules must be protected by a magnetothermal circuit breaker and a differential dedicated circuit breaker. Equipments are resistant to transient overvoltages specified in regulations, and must be installed on different circuits separated from each other inductive loads (inductive ballasts, motors, fans etc. ....)



**Differential circuit breaker.**

The function of the anti-interference filters in control gear is to divert interference to the earth wire as leakage current. In triphase systems: Distribute the light fixtures equally between the three phases. The leakage currents will compensate each other. In monophasic systems: Consult table.

**Automatic circuit breaker.**



The ignition of LED modules with these control gears is simultaneous. At the moment of connection, the equipment's capacitors create a strong pulse of current of very short duration, this is called Inrush current. The installation of a maximum number of control gear depending on the type and characteristics of the magnetothermal protection is recommended. See table.


Type	Inrush Current		Max no. of equipment per circuit breaker				RCCB 30mA
	I. Peak	Time	Type B		Type C		
	A	µs	10A	16A	10A	16A	
LV 100/12-T-IP67 LV 100/24-T-IP67	< 75 A	100	1	3	3	5	42
LV 200/12-T-IP67 LV 200/24-T-IP67	< 75 A	100	2	3	2	4	42
LV 300/12-T-IP67 LV 320/24-T-IP67	< 100 A	380	1	2	2	3	42

**CONSTANT VOLTAGE CONTROL GEAR FOR LED MODULES AND PROTECTION SYSTEM RESPONSE**

Type	Absence of LED module. Open circuit	Overload	Short-circuit	Overtemperature
LV ...-T-IP67	Blocks	Automatically re-start when problem is solved	Automatically re-start when problem is solved	Blocks

Block: The driver is in protection mode. The disconnection and connection of the mains will make operate again the equipment.

**WIRING DIAGRAMS**

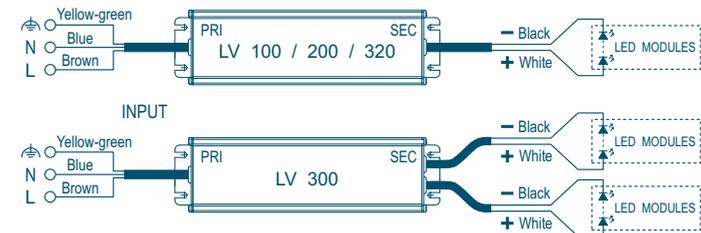

**MOUNTING LOCATION DIMENSION**

